



REPORT 18/13031.5 24 July 2018

OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Taraflex Surface sheet vinyl

Prepared for: Jutta Fronert

Gerflor Australasia Pty Ltd

17 Cato Street

HAWTHORN EAST VIC 3123

Specimen Description: Taraflex Surface sheet vinyl, 497x1075 mm.

No. of Specimens: 1 off

Surface Structure: Structured

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Fixed

Test Direction: Test direction not applicable.

Joint Type & Width: N/A
Air Temperature: 21°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface

materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR, Unit 1, 64 Bridge Road, Keysborough.

Test Date: 19 July 2018

Test Personnel: Awel Guled and Dale Siegle

Displacement Space	Not tested	
(rounded to the nearest 0.5cm³/dm²):		
Displacement Space Assessment Group	Not tested	
(Appendix E, AS 4586 - 2013):		
Corrected mean overall acceptance angle (α_{ave})		
(rounded down to the nearest degree):	0	
Classification:	R9	

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Dale Siegle

Compliance and Test Technician

Reviewed By:


Marcus Braché

Senior Engineering Technician

Approved Signatory



REPORT 18/13031.5 24 July 2018

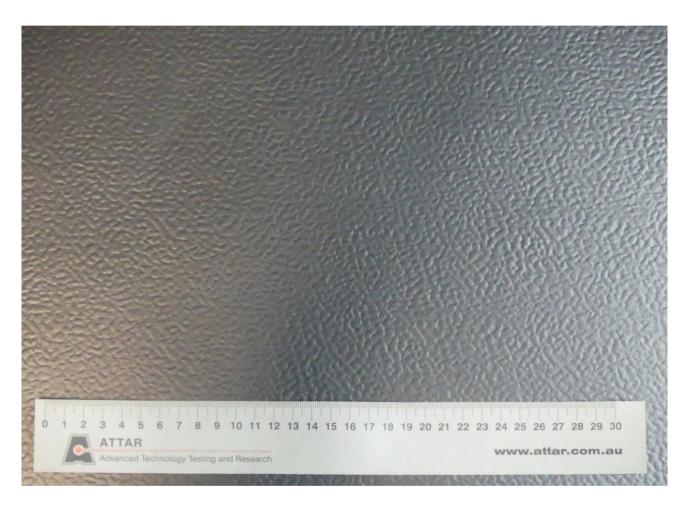

Taraflex Surface sheet vinyl Figure 1:



CLASSIFICATION CRITERIA - AS 4586 - 2013 Oil Wet Inclining Platform Test - Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIANSURFACE MATERIALS ACCORDINGTO THE **OIL-WET INCLINING PLATFORM TEST**

Classification	Angle, degrees
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35